



SECTION A-A

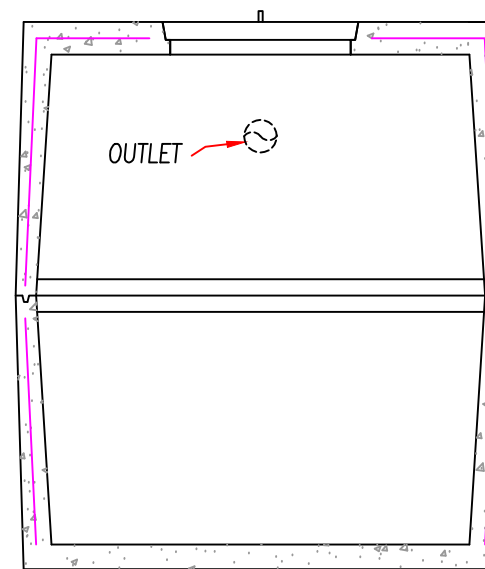

SECTION B-B

NOTES:

1. PRECAST CONCRETE CONFORM TO ASTM-C1227
2. CONCRETE TO BE 4500 PSI AT 28 DAYS
3. FINISH (F): SMOOTH FORM FINISH
4. COLOR: NATURAL GRAY
5. WELDED WIRE MESH AND OR REBAR REINFORCING
6. VOLUME OF FIRST COMPARTMENT IS APPROXIMATELY $\frac{3}{4}$ THE TOTAL VOLUME OF TANK
7. GASKETS TO ACCOMMODATE 4" PVC

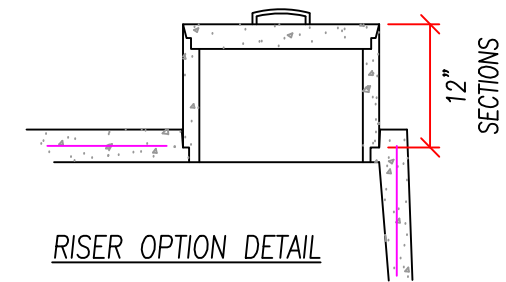

CONTRACTOR PROJECT NAME PROJECT LOCATION	DATE: 11-9-12
	REVISIONS
NOTES, DIMENSIONS	
PANHANDLE CONCRETE PRODUCTS, INC. 2202 WEST OVERLAND SCOTTSBUFF, NEBRASKA 69361 PH: (508) 652-2161 FAX: (508) 652-2771	
DRAWING NAME: 1250 GALLON SEPTIC TANK	
DRAWN/CHECKED BY: AIH	
SCALE: NONE	
DATE: 4-17-08	
JOB NO. XXX	
DRAWING FILE: 1250 GAL SEPTIC TANK	
SHEET NO. ST-1250	