
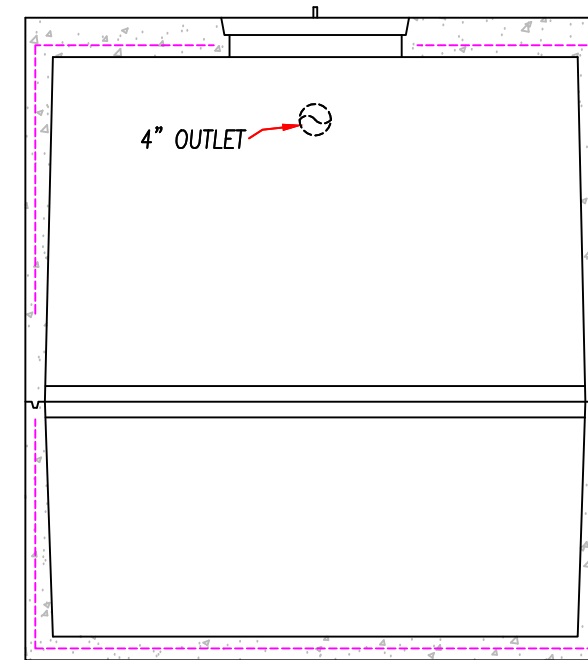


SECTION A-A

- NOTES:**
1. PRECAST CONCRETE CONFORM TO ASTM-C1227
 2. CONCRETE TO BE 4500 PSI AT 28 DAYS
 3. FINISH (F): SMOOTH FORM FINISH
 4. COLOR: NATURAL GRAY
 5. WELDED WIRE MESH OR REBAR REINFORCING
 6. VOLUME OF FIRST COMPARTMENT IS APPROXIAMTELY $\frac{1}{3}$ THE CAPACITY OF THE TANK'S TOTAL VOLUME
 7. GASKET TO ACCOMODATE 4" PVC
 8. SANITARY TEES PROVIDED BY PCP

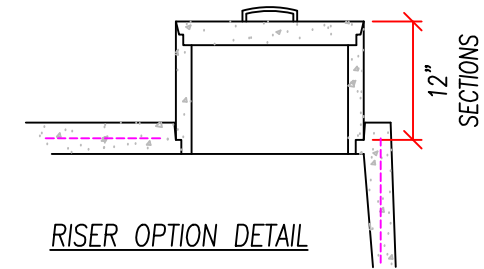

SECTION B-B

CONTRACTOR PROJECT NAME PROJECT LOCATION	DATE:	11-12-12
	REVISIONS	
	NOTES, DIMENSION	
PANHANDLE CONCRETE PRODUCTS, INC. 2202 WEST OVERLAND SCOTTSBLUFF, NEBRASKA 69361 PH: (308) 652-2161 FAX: (308) 652-2771		
DRAWING NAME: 2000 GALLON SEPTIC TANK		
DRAWN/CHECKED BY: AIH		
SCALE: NONE		
DATE: 1-21-08		
JOB NO. XXXX		
DRAWING FILE: 2000 GAL SEPTIC TANK		
SHEET NO. ST-2000		